

Submittal Data Sheet

CS-Z15AKUAW

Mini Split Indoor Unit

Job Name: _____
 Location: _____
 Engineer: _____
 Submitted to: _____
 Submitted by: _____
 Reference: _____

Approval: _____
 Date: _____
 Construction: _____
 Unit #: _____
 Drawing #: _____

Power Supply

Power Supply (V/PH/Hz) 208-230 / 1 / 60

Noise Levels

Cooling:
 Indoor Noise (H / L / QLo) dB (A) 45 / 37 / 30
 Indoor Power Level (dB) 61
 Heating:
 Indoor Noise (H / L / QLo) dB (A) 46 / 37 / 30
 Indoor Power Level (dB) 62

Indoor Fan Stats

Fan Type Crossflow Fan
 Motor DC (8-poles)
 Input Power (W) 47.3
 Output Power (W) 30

Indoor Fan Speeds


QLo Cool / Heat (rpm) 720 / 730
 Lo Cool / Heat (rpm) 870 / 920
 Med Cool / Heat (rpm) 1010 / 1100
 Hi Cool / Heat (rpm) 1160 / 1260
 SHi Cool / Heat (rpm) 1210 / 1310

Indoor Airflow

QLo Cool / Heat (CFM) 251 / 256
 Lo Cool / Heat (CFM) 319 / 341
 Med Cool / Heat (CFM) 381 / 422
 Hi Cool / Heat (CFM) 450 / 495
 SHi Cool/Heat (CFM) 471 / 516

Indoor Heat Exchanger

Fin Material Aluminum (Pre-Coat)
 Fin Type Silt Fin
 Row x Stage x FPI 2 x 17 x 21
 Size (W x H x L) (in) 1 x 4 x 21 (sub eva)
 25-3/8 x 3-47/64 x 1/2 (sub eva)

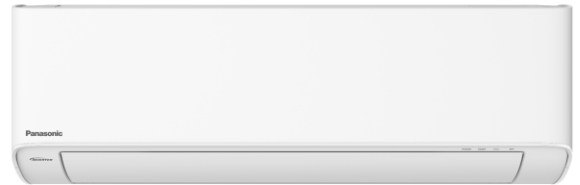

Intertek



Indoor Operating Range

	Dry Bulb	Wet Bulb
Cooling		
Minimum °F (°C)	60.8 (16)	51.8 (11)
Maximum °F (°C)	89.6 (32)	73.4 (23)
Heating		
Minimum °F (°C)	60.8 (16)	-/-
Maximum °F (°C)	86.0 (30)	-/-


Dimensions and Weight

Height x Width x Depth (in) 11-5/8 x 34-9/32 x 9-1/32
 Weight (lb.) 24

Piping Metrics

Pipe Diameter Liquid / Gas (in)	
- Liquid	1/4"
- Gas	1/2"
Standard Length (ft.)	25
Length Range (ft) (min-max)	10 - 66
Indoor (CS) & Outdoor (CU) Max Height Difference (ft)	49.2
Additional Gas Amount (oz/ft)	0.2
Length for Additional Gas (ft)	25
Drain Hose	
- Inner Diameter (in)	0.66
- Length (in)	25.6

Indoor Dimensions

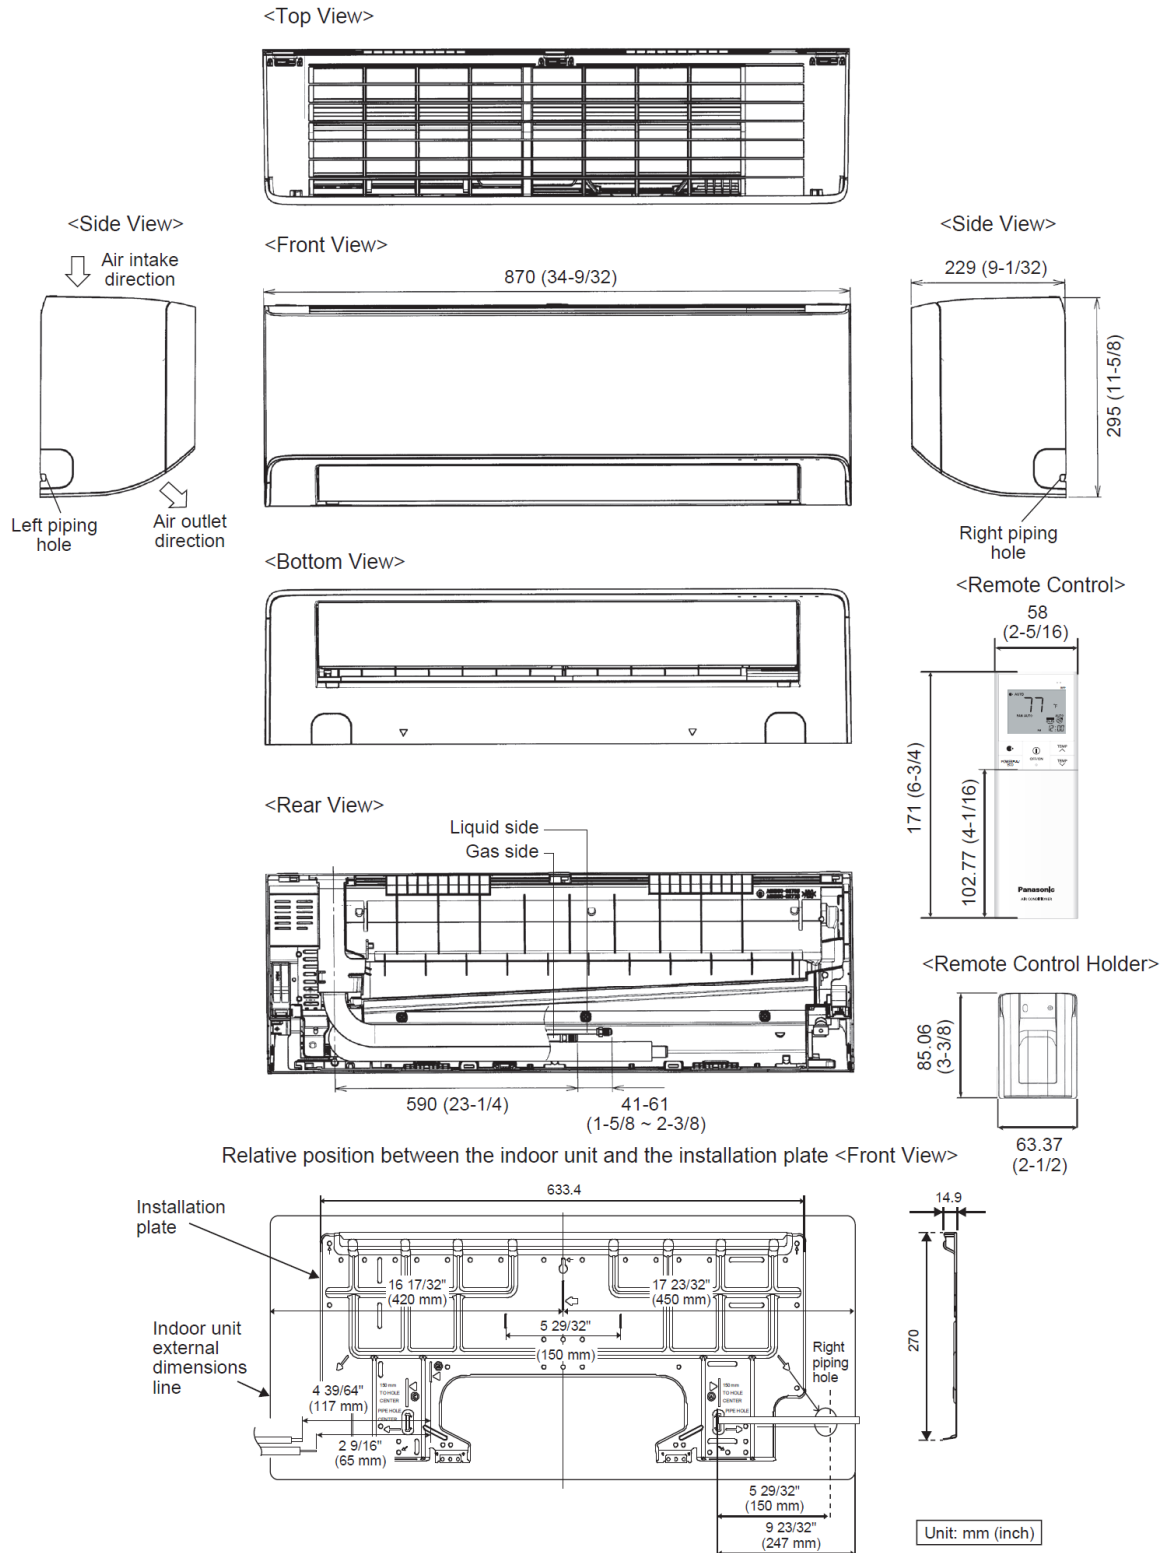

Panasonic Canada

5770 Ambler Drive
Mississauga, ON L4W 2T3
<https://na.panasonic.ca/indoor-air-quality/hvac>

breathe well
The Only Complete Air Quality Solution™